



- HOT GAS IN
- LIQUID OUT

ALWAYS CHECK POLARITY AND CORRECT ROTATION OF FANS
 FANS CAN BE PUSHERS OR PULLERS DEPENDING ON YOUR CHOICE
 IF FAN IS REMOVED, DIRECTION OF AIRFLOW IS WRITTEN ON BLADE

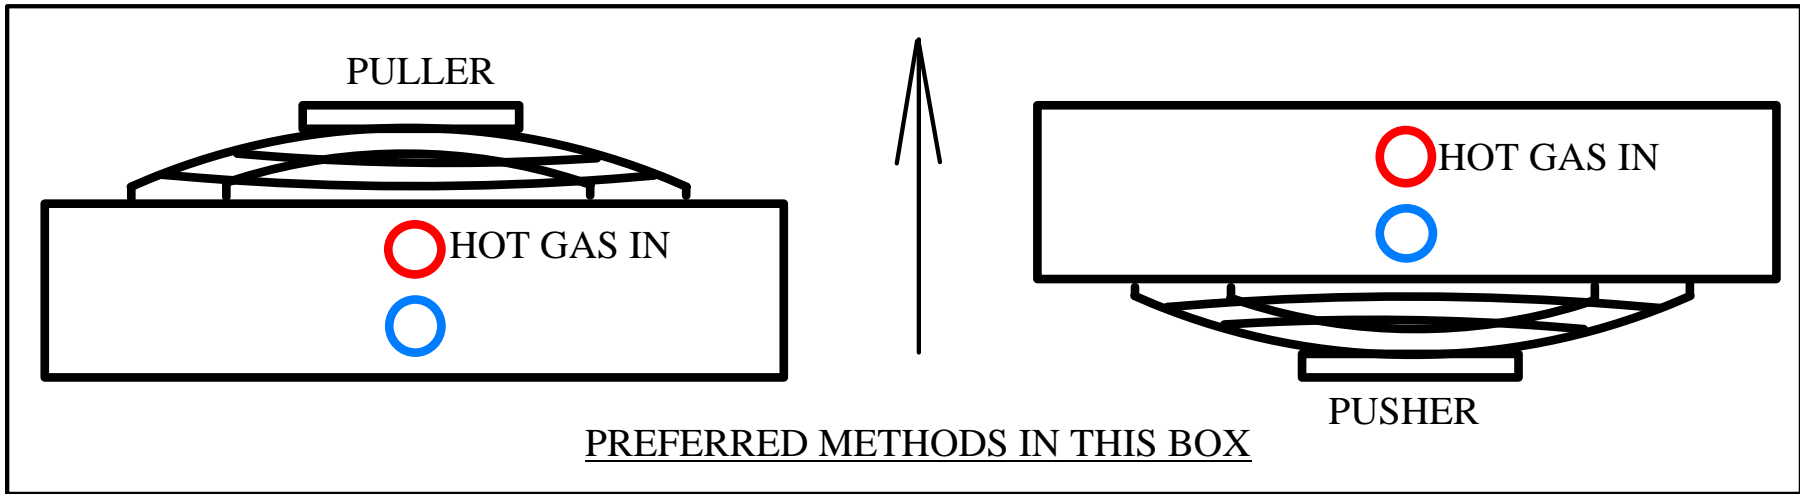

AIRFLOW

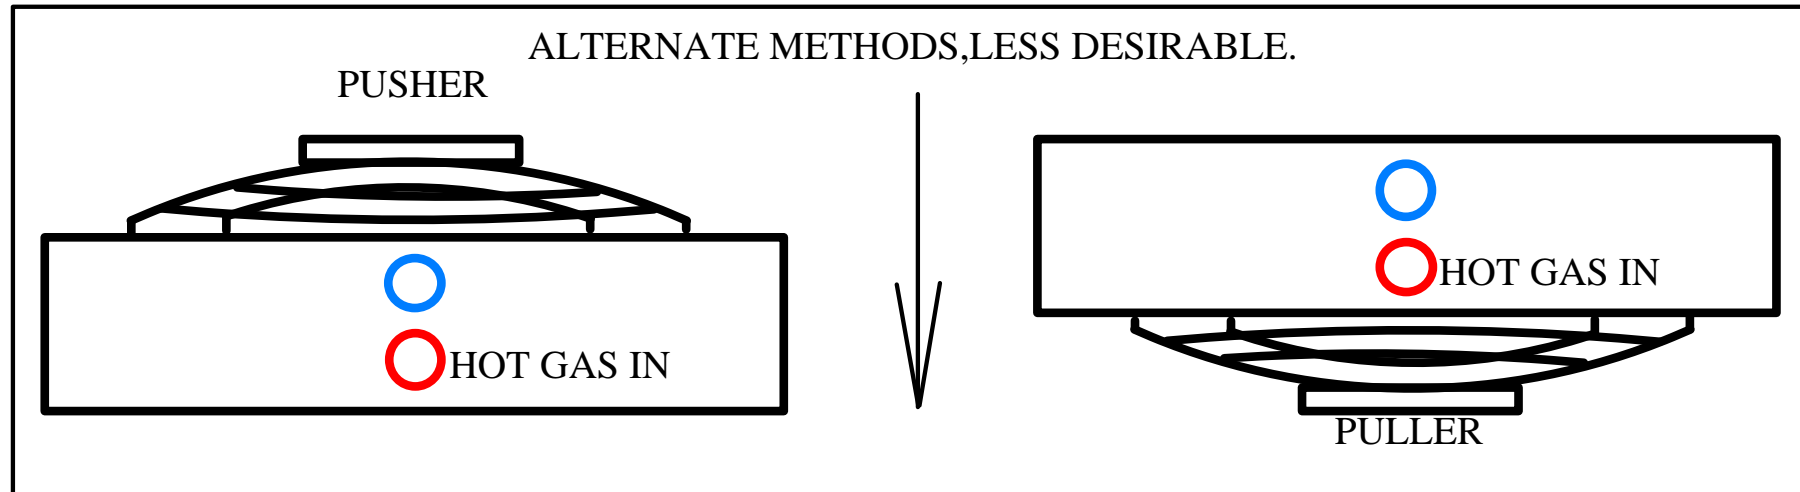

FOR MULTI-ROW COILS
 LIQUID LINE SHOULD ALWAYS RECEIVE AIR FIRST

DANHARD, INC.			
TITLE			
COND-ROUTING			
SIZE	CAGE CODE	DWG NO	REV
A			
SCALE	2014-MN		SHEET